


BIORETENTION FACILITY PLAN

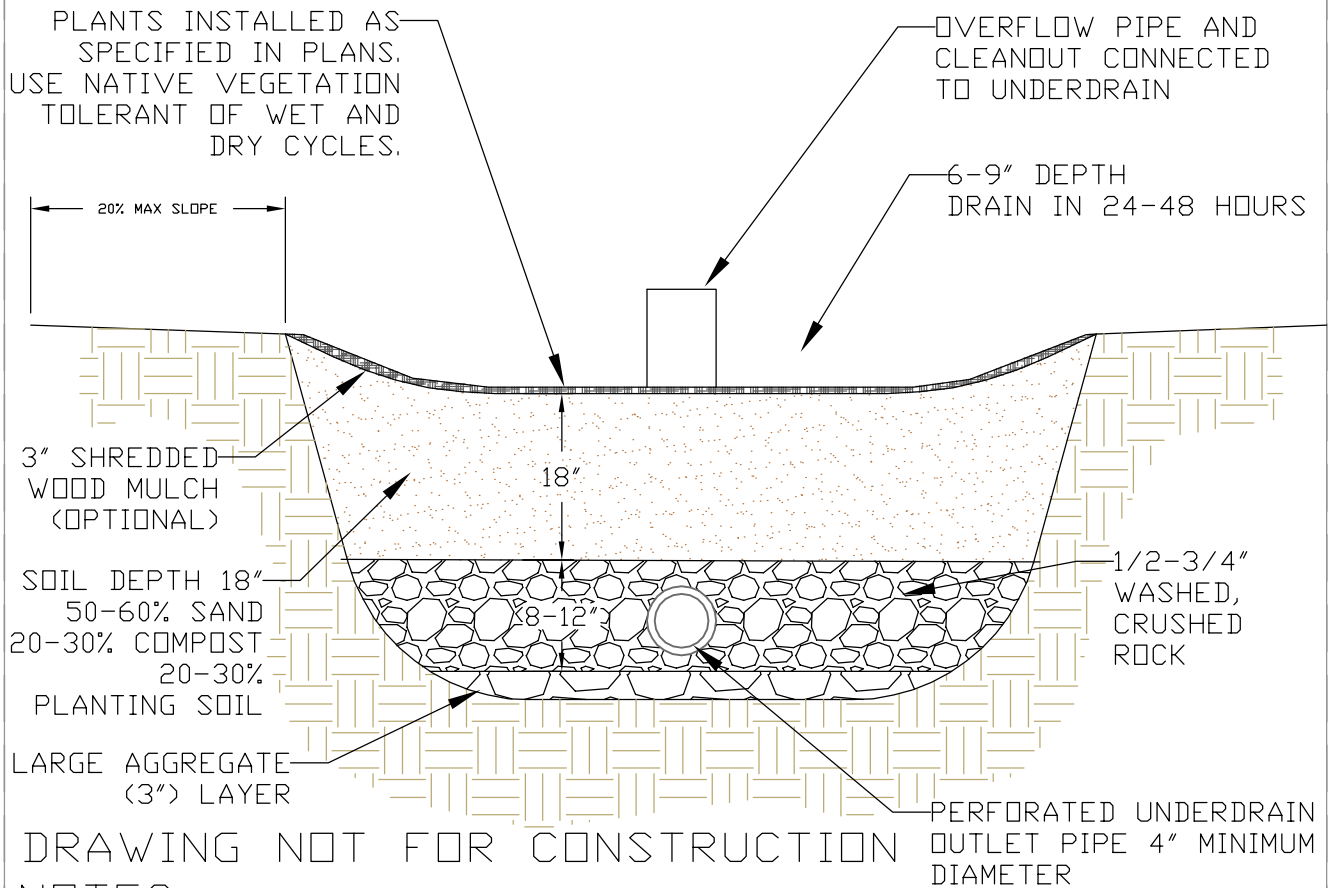

NOTES:

1. LOCATE FACILITIES AT LEAST 100 FEET FROM ANY WELLS OR SOURCE WATER LOCATIONS.
2. LOCATE FACILITY AT LEAST 25 FEET FROM ANY SEPTIC FIELDS AND UPGRADIENT IF POSSIBLE.
3. LOCATE FACILITY AT LEAST 25 FEET AND DOWNGRADIENT FROM BASEMENTS.
4. LOCATE FACILITY 5 FEET OR GREATER FROM A SLAB OR FOUNDATION.
5. RECOMMENDED MINIMUM AREA SHALL BE 200 SQUARE FEET WITH THE LENGTH AT A 2:1 RATIO OF THE WIDTH.
6. ADDITIONAL REGULATIONS MAY BE REQUIRED BY LOCAL ORDINANCES.
7. A GEOTEXTILE FABRIC SEPARATING THE LARGE AGGREGATE AND SOIL IS OPTIONAL.
7. DRAWING NOT TO SCALE.

REFERENCE

Project _____
 Designed _____ Date _____
 Checked _____ Date _____
 Approved _____ Date _____



STANDARD DWG. NO.

IUM-500

SHEET 1 OF 1

DATE 11-18-13