



TEMPORARY SEDIMENT TRAP (ROCK OUTLET)

DRAINAGE AREA LIMITED TO 1-5 ACRES

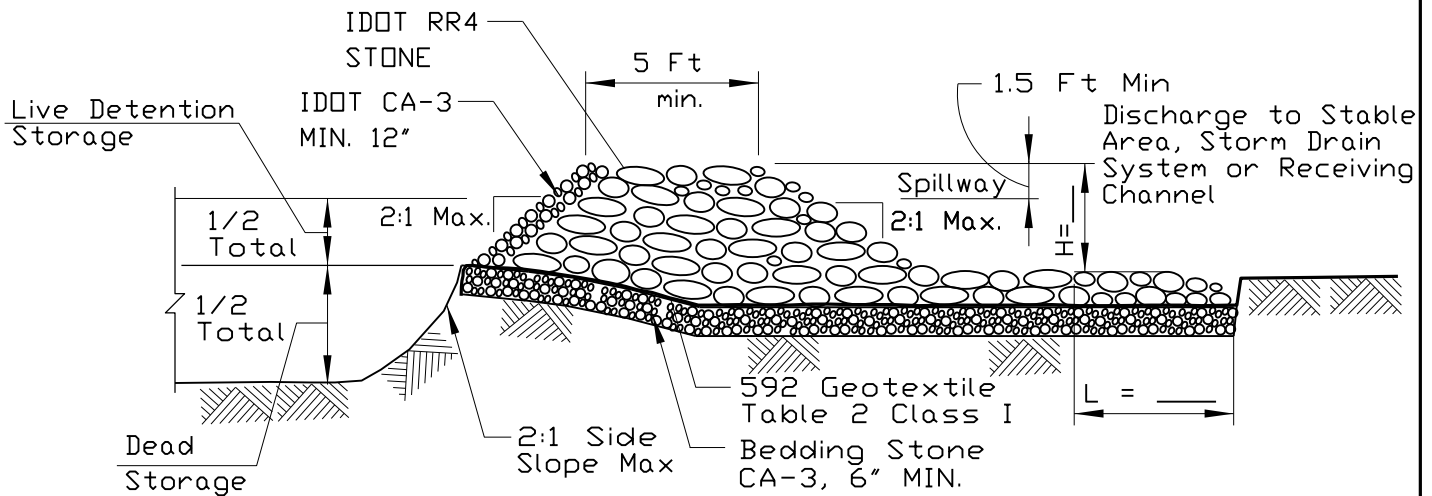

CROSS SECTION

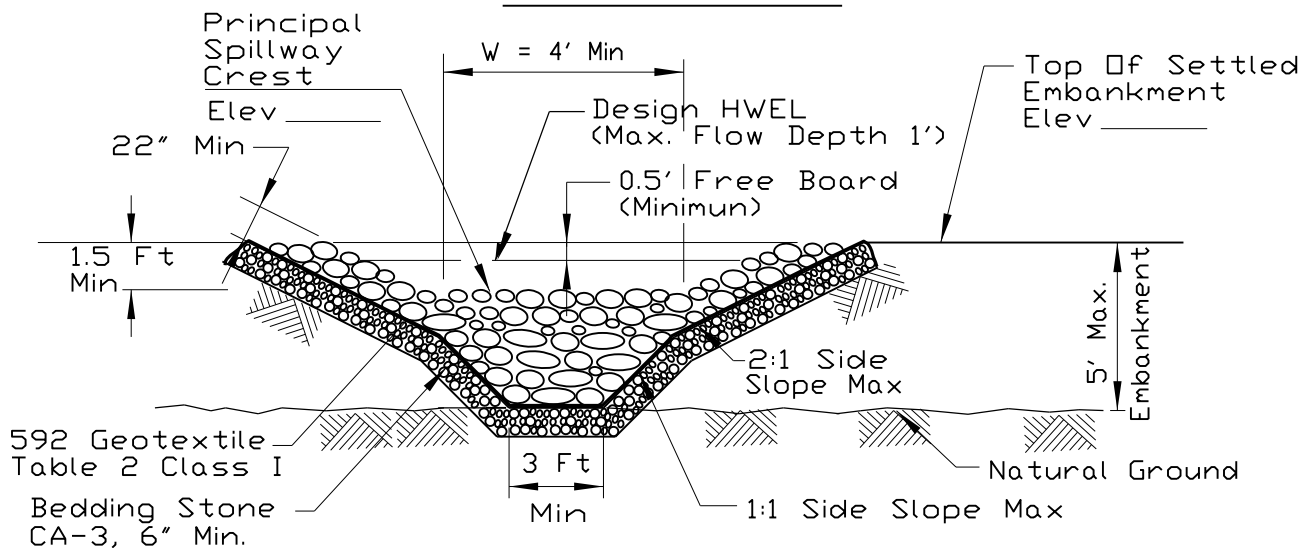

ROCK OUTLET SECTION

NOTES:

1. The sediment drop side slopes shall be constructed 2:1 or flatter and temporarily stabilized.
2. The rock outlet fill shall be constructed using IDOT RR-4 stone size. A 1' layer of IDOT CA-3 should be placed on the inside face to reduce the flow rate.
3. The rock will be placed according to construction specification 25 ROCKFILL. Placement will be by Method 1 and compaction will be class III.
4. The geotextile shall meet the requirements in material specification 592 GEOTEXTILE table 2, class I.

REFERENCE			
Project	_____	Date	_____
Designed	_____	Date	_____
Checked	_____	Date	_____
Approved	_____	Date	_____



STANDARD DWG. NO.
IUM-660R
SHEET 1 OF 1
DATE 10-05-2017