


TEMPORARY SEDIMENT TRAP (PIPE OUTLET)

DRAINAGE AREA LIMITED TO 1-5 ACRES

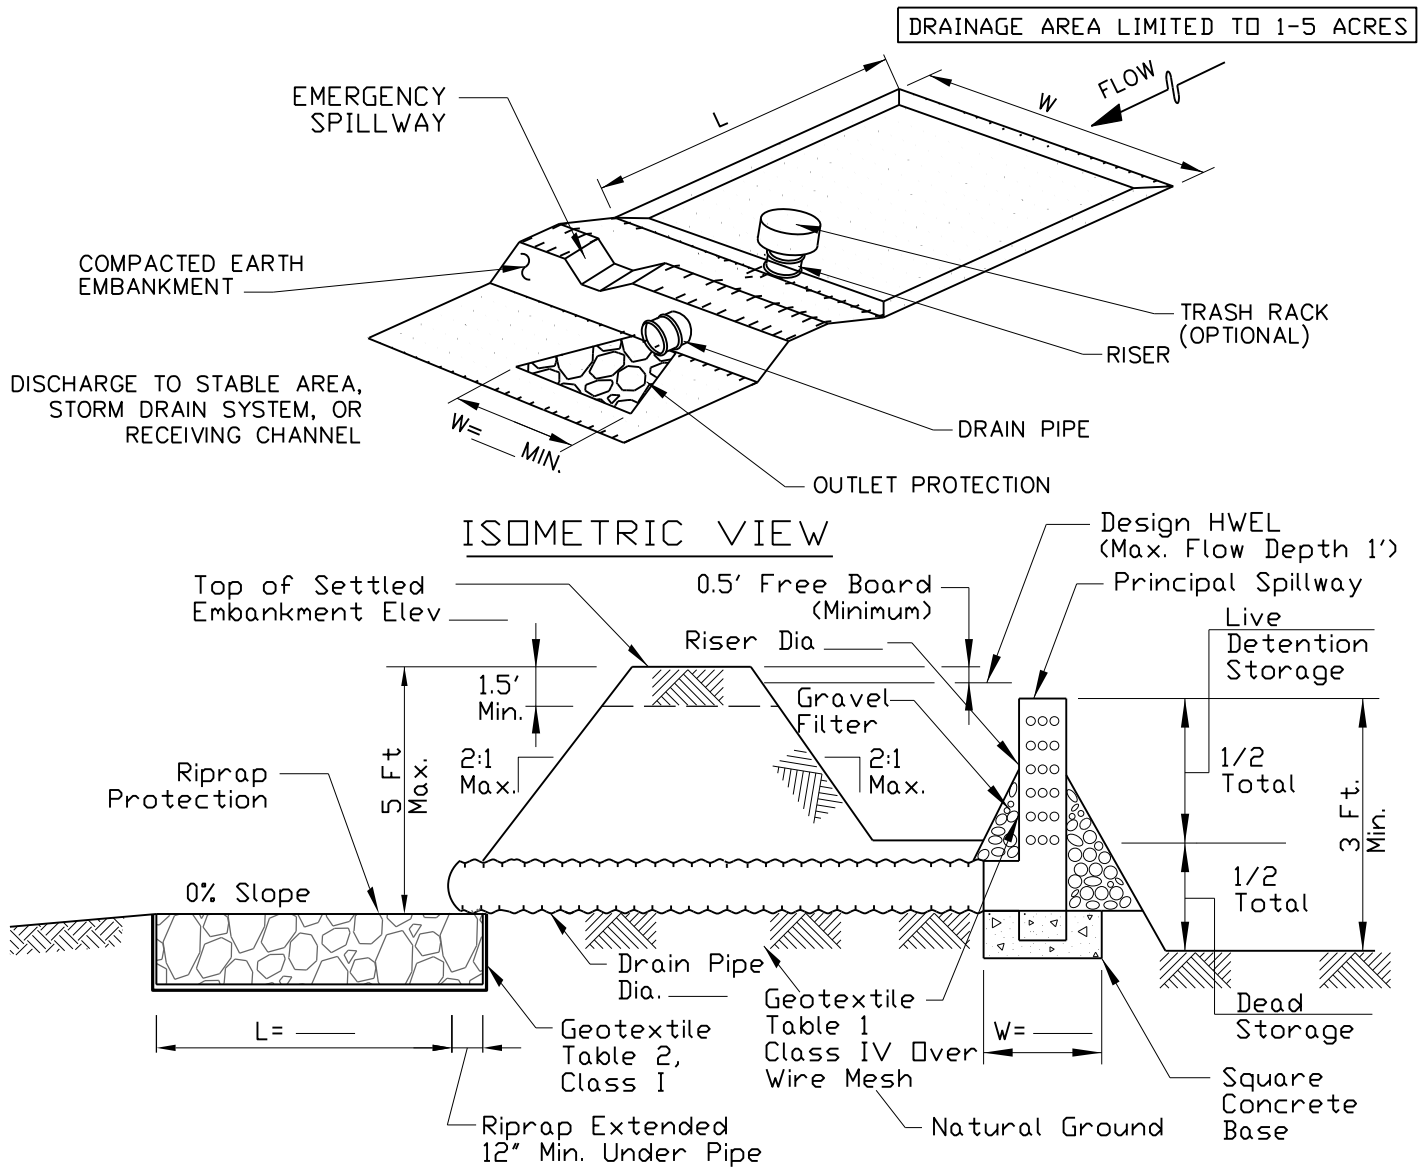

NOTES:

1. Riser with slotted inlets shall be fabricated from corrugated metal, polyethylene or smooth steel.
2. Slots shall be cut cleanly and deburred. Ends of slots may be round or square.
3. Gravel filter, if used, shall be a maximum stone diameter of 2".
4. Principal spillway shall be fabricated or standard elbow; fabricated or standard tee with the pipe or plug in upstream end; or standard tee with one end embedded in concrete.
5. The emergency spillway must be stabilized and/or armored as appropriate based upon overflow velocities.
6. Minimum top width of compacted earth embankment shall be 5'.

REFERENCE

Project _____
 Designed _____ Date _____
 Checked _____ Date _____
 Approved _____ Date _____



STANDARD DWG. NO.

IUM-660P

SHEET 1 OF 1

DATE 10-05-2017