



TEMPORARY SEDIMENT TRAP (ROCK OUTLET)

DRAINAGE AREA LIMITED TO 1-5 ACRES

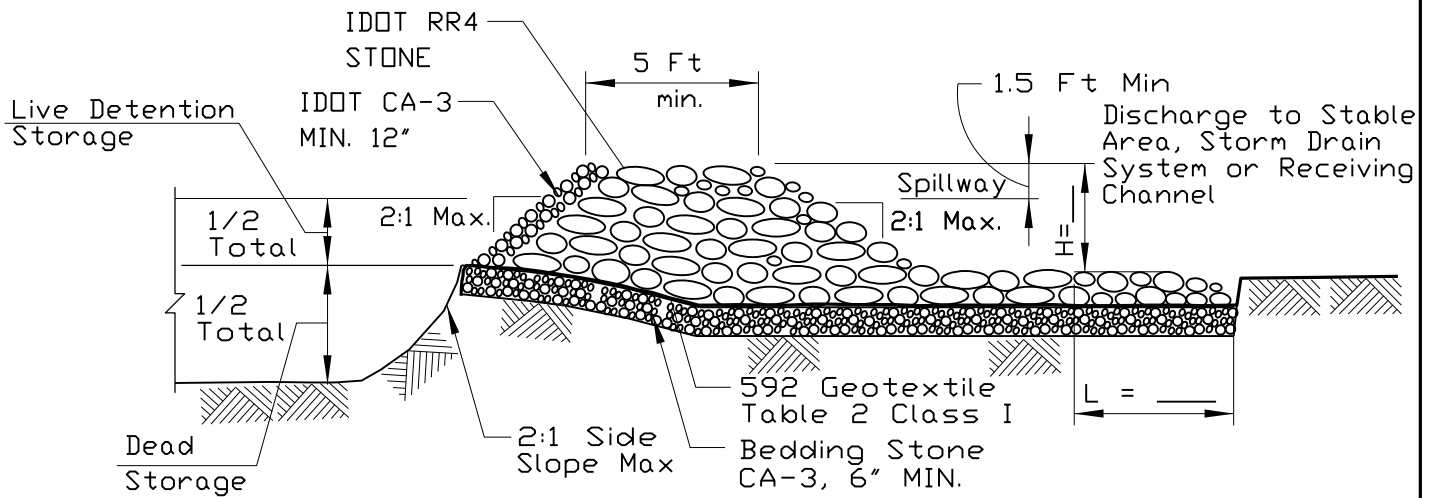

CROSS SECTION

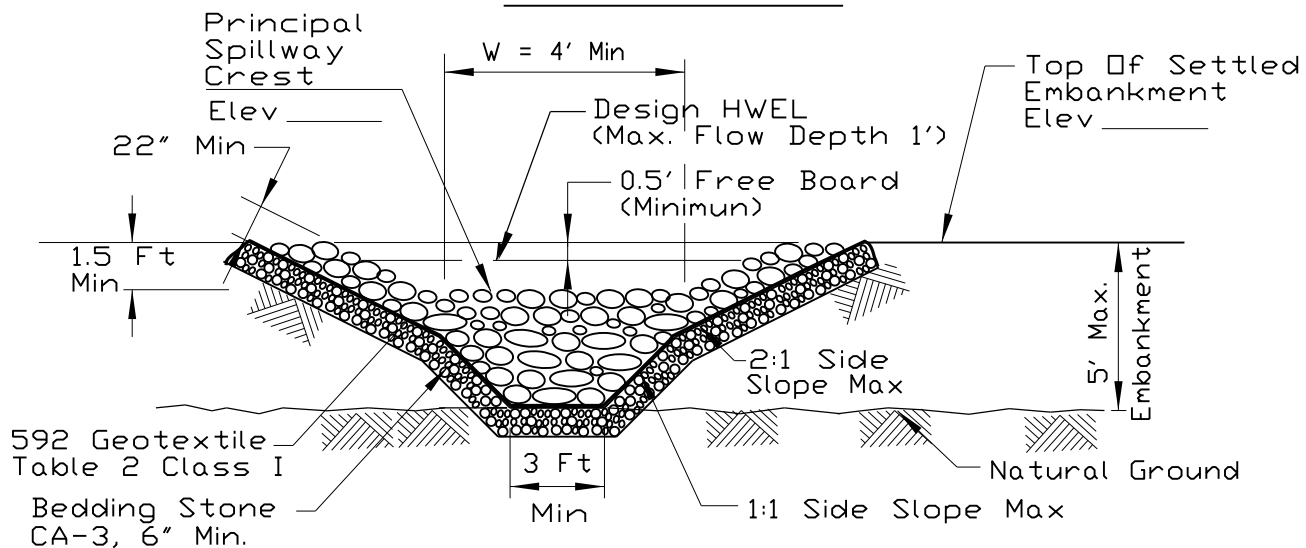

ROCK OUTLET SECTION

NOTES:

1. The sediment drop side slopes shall be constructed 2:1 or flatter and temporarily stabilized.
2. The rock outlet fill shall be constructed using IDOT RR-4 stone size. A 1' layer of IDOT CA-3 should be placed on the inside face to reduce the flow rate.
3. The rock will be placed according to construction specification 25 ROCKFILL. Placement will be by Method 1 and compaction will be class III.
4. The geotextile shall meet the requirements in material specification 592 GEOTEXTILE table 2, class I.

REFERENCE

Project _____
Designed _____ Date _____
Checked _____ Date _____
Approved _____ Date _____



STANDARD DWG. NO.

IUM-660R

SHEET 1 OF 1

DATE 10-05-2017