


# INLET PROTECTION LOG TYPE

NOT TO SCALE

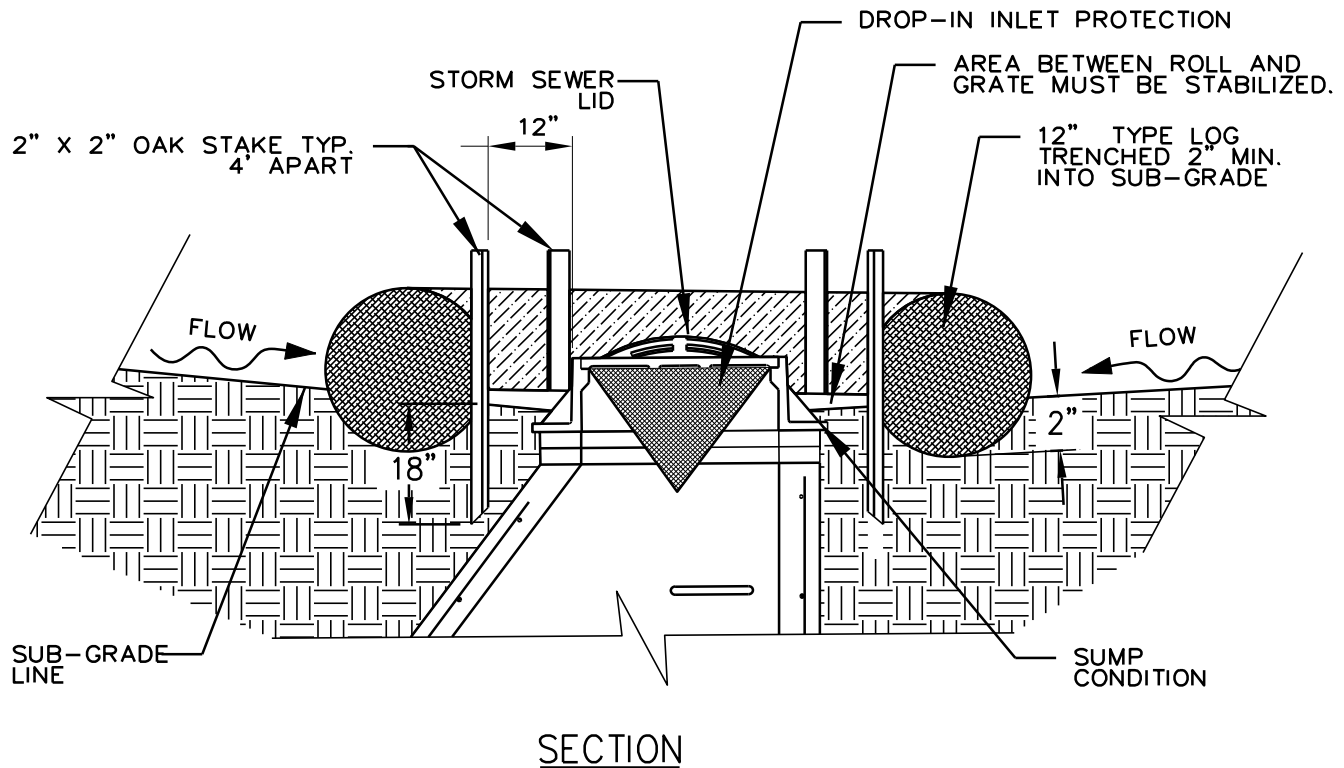

NOTES:

1. 2" x 2" nominal hardwood stakes, 4 foot minimum length, driven into ground approximately 18 inches, stakes driven a minimum width of 12 inches away from the drop inlet.
2. Area inside the log, from edge of fabric to structure, must be stabilized with erosion control blanket. Turf Reinforcement Mat, Geotextile 592 Table 2 Class 2 or CA-7 stone.
3. The maximum distance between the stakes should be 4 feet.
4. A maintenance schedule must maintain a sediment accumulation of less than 50% of the height of the log.

## REFERENCE

Project \_\_\_\_\_

Designed \_\_\_\_\_ Date \_\_\_\_\_

Checked \_\_\_\_\_ Date \_\_\_\_\_

Approved \_\_\_\_\_ Date \_\_\_\_\_



STANDARD DWG. NO.

IUM-562

SHEET 1 OF 1

DATE 11-30-2015