
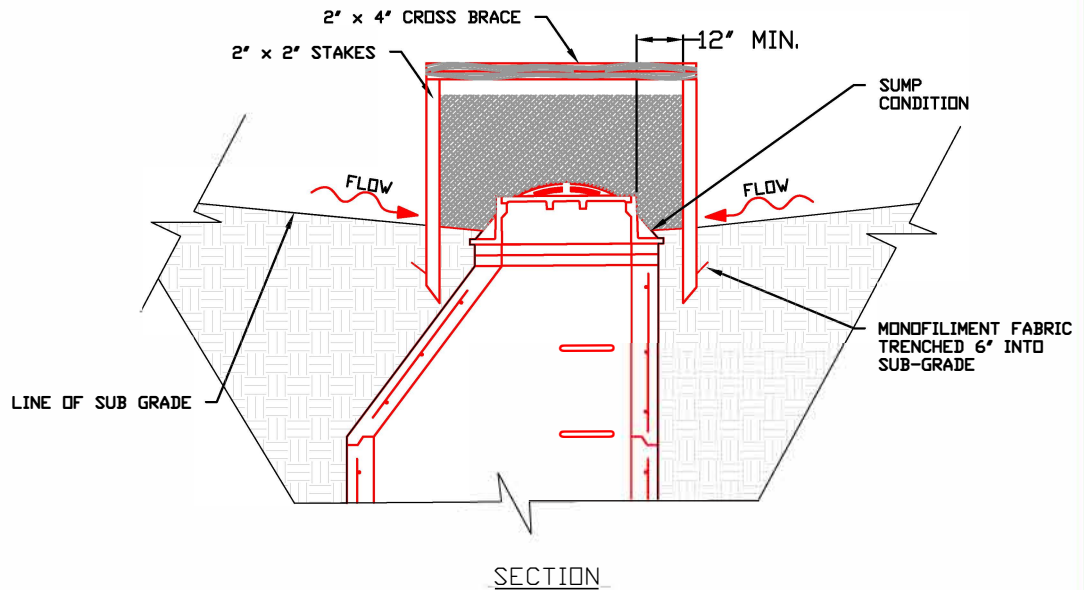


INLET PROTECTION - MONOFILAMENT FABRIC BARRIER FENCE

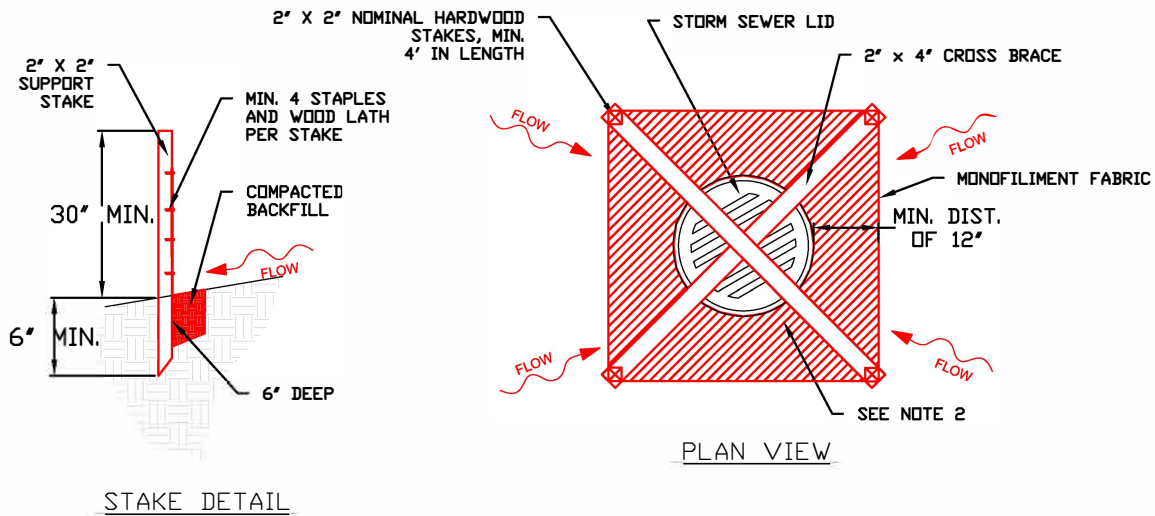

NOTES:

1. 2 x 2 nominal hardwood stakes, 4 foot minimum length, driven into ground approximately 18 inches, stakes driven a minimum width of 12 inches away from the drop inlet.
2. Area inside the fence, from edge of fabric to structure, must be stabilized with Erosion Control Blanket, Turf Reinforcement Mat, Geotextile 592 Table 2 Class 2 or CA-7 stone
3. Maximum height of the fabric above the crest of the drop inlet shall be 30". Place the bottom 6 inches of the fabric in a trench and backfill with 6 inches of 95% compacted soil.
4. Stakes must be a maximum of 4 feet apart.
5. A maintenance schedule must maintain a sediment accumulation of less than 50% of the height of the monofilament fabric.
6. Monofilament fabric shall meet the requirement of Material Specification 592 Geotextile Table 1, Class 4.
7. Monofilament fabric shall be secured to each 2" x 2" nominal hardwood stake with a minimum of 4 steel staple fasteners and wood lath. Wood lath shall be a minimum length of 10 inches. Wire fasteners should be used if metal T-Posts are installed in place of hardwood stakes.

REFERENCE

Project _____
 Designed _____ Date _____
 Checked _____ Date _____
 Approved _____ Date _____

STANDARD DWG. NO.

IUM-560

SHEET 1 OF 1

DATE 04-6-15